

Honeywell

THE POWER OF **CONNECTED**

April 6th, 2018

Re: VOLUNTARY RECALL OF CEDAPRIN TABLETS AND FIRST AID KITS

Dear Distributor Partner,

Reason for Recall: Honeywell has learned that a limited number of lots of Cedaprin, pain relieving tablets, might have an odor. Cedaprin tablets are sold in cardstock dispensers as well as used in first aid kits. We are confident that the root cause has been identified and resolved by our supplier. To minimize a poor customer experience, we are initiating a voluntary recall of affected products you may have in inventory. *This recall is strictly for on-hand inventory and does not need to be extended to end-users.*

Risk to Health: Adverse health effects are very remote.

Instructions to Customers:

The affected products shipped from our distribution centers from December 2016 to January 2018. To simplify the recall process we have partnered with Stericycle, whom will help us coordinate the different aspects of this recall.

Upon the receipt of your return of affected products, we will issue a refund to your account regardless of the product expiration date. Please take the following actions to help remove these items from your inventory:

1. Identify if the product in your possession is affected. Locate the lot number on the dispensers or first aid kits and cross-reference with the enclosed list of affected lots. Reference images 1 through 6 for assistance in locating the lot number.
2. Stop sales and usage of any affected products.
3. Use the enclosed return label to return all product in your possession to the addresses below. If necessary, please request additional return labels by contacting 855.215.5291.

Honeywell Safety Products USA
C/O: Cedaprin Recall
875 E Patriot Blvd, Ste 208
Reno, NV 89511

4. Complete the enclosed 2 page Return Response Form to include with your return.
5. We will issue a credit to your account immediately upon the receipt of the returned goods.
6. Replenish your stock by placing an order as you normally do.

We are conducting this recall in cooperation with the U.S. Food and Drug Administration. We sincerely appreciate your response by April 30th, 2018.

If you have any questions, please do not hesitate to contact customer support at 855.215.5291, Monday – Friday, 8:00 AM – 5:00 PM EST or via email at Honeywell7201@stericycle.com.

Sincerely,

Isabel Ferreira
Product Marketing Manager
Honeywell Safety Products

7201_02_01AD_V2.1

LOCATING LOT NUMBERS - the below images highlight the most common locations for lot number location. Actual location may vary.

Cedaprin cardstock dispenser

Dispenser (brand may vary) Dispenser bottom Dispenser bottom close-up



Image 1

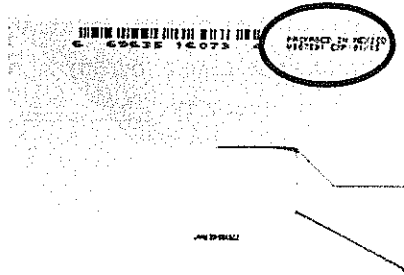


Image 2

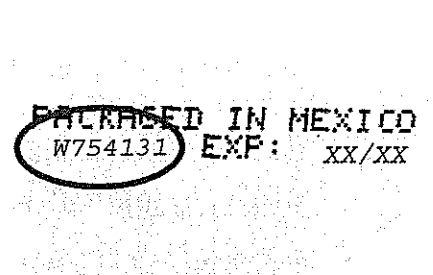


Image 3

First Aid Kits

Case Label First Aid Kit Label Secondary First Aid Kit Label

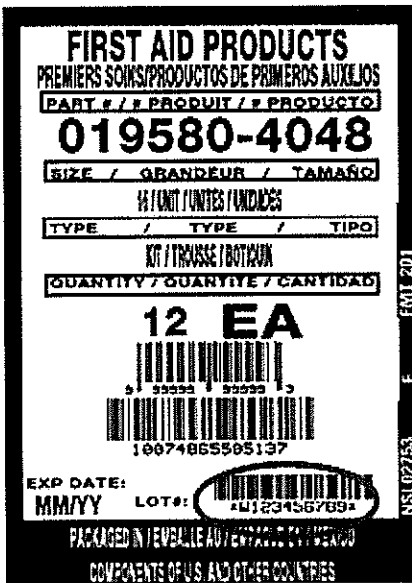


Image 4

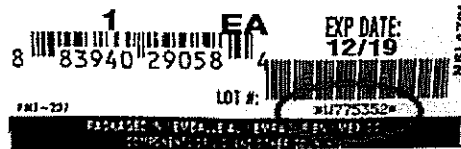


Image 5

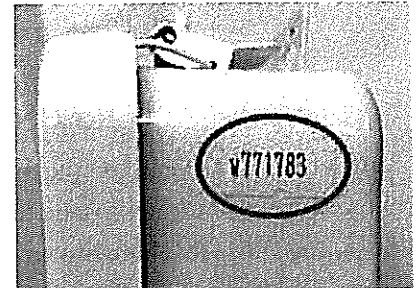


Image 6

RETURN RESPONSE FORM Page 1 of 2

Please check ALL appropriate boxes.

- I have read and understand the instructions provided on this letter.
- I have checked my stock and confirm that none of the recalled lots are in my possession.
- I have checked my stock and have segregated inventory as instructed.
- I created a record of the affected lots and quantities in my possession, recorded it on the table below and will include it with my return.
- I will package the products affected appropriately and return promptly.
- I have NOT received any reports of adverse events associated with the recalled product.
- I have received reports of adverse events associated with the recalled product. Please explain: _____

Company Name: _____

Company Address: _____

Name (printed): _____

Signature: _____ Date: _____

PLEASE INCLUDE BOTH PAGES OF THIS FORM WITH YOUR RETURN

RETURN RESPONSE FORM Page 2 of 2

FG Item #	FG Lot #	Description	QTY Returned
018512-4219	W758185; W758402; W763288; W763287; W769402; W770704; W777467; W781637	4219 SOFT PACK PROMO RETAIL	
166180-H5	W754131; W755117; W755027; W758895; W758126; W760229; W761444; W762969; W764815; W766075; W767704; W769903; W771208; W772501; W775907; W777672; W778860	CEDAPRIN (IBUPROFEN) 2ENV 100	
166183	W748352; W750935; W754132; W755808; W758896; W760545; W762970; W765301; W767326; W769639; W771212; W774987; W775908	CEDAPRIN (IBUPROFEN) 2ENV 250	
166185	W753189; W755028; W757529; W758763; W760546; W762523; W764423; W765302; W768723; W770762; W774689; W775909	CEDAPRIN (IBUPROFEN) 2ENV 500	
6837954	W788046	ANSI+ FILL/FAK 24UP	
68P24AG	W782227; W781649; W785634; W787858; W789935	FILL/FAK 24U PL	
FAK4SHLF-CLSB	W749330; W753141; W758853; W769573; W773832; W776733; W792441	4SHLF IND W/LINER CLASS B	
FAK9W/GOLF	W767671; W772866; W770566; W780454	GOLFERS KIT	
FAKTRAVEL	W760213; W766294; W769195; W770740; W770739; W770882; W771793; W773611; W773610; W775687; W775059; W780289; W778247; W781177; W788628; W789604	TRAVEL PREPAREDNESS KIT	
SF00003967	W758447; W766291	10 PERSON STEEL	
SF00003968	W758448; W766292; W776366	10P REFILLSF00003967	
SF00004292	W755106; W763319; W764403; W768695; W777189; W785386; W793302; W792464; W801505	5063 4SHLF FILL/LOGO 400 LINER	
SF00004422	W783424	5264 4SHLF STND INDUST FILL	
Z019813	W768025; W792741	ALL PURPOSE FAK	
Z019836	W757071; W773113	OUTDOOR SURVIVAL	
Z019838	W756589; W756788; W757211; W757069; W757210; W757478; W757744; W759449; W760021; W767670; W790276	GPL 52 PC ALL PURPOSE FAK	
Z019840	W756466; W774634; W776719; W781159; W783941; W788730; W792743	200 PC ALL PURPOSE FAK	
Z166180	W751395; W751889; W754106; W755675; W757300; W757299; W757301; W757302; W767013; W767321; W772110; W771829; W773135; W774409; W777091; W777782; W781406	CEDAPRIN	
Z166183	W739528; W755018; W55785; W757785; W759252; W759362; W759253; W767920; W768716; W770900; W774404; W778616	CEDAPRIN	
Z166185	W752751; W753071; W753184; W753840; W754020; W754112; W754598; W754859; W755369; W755370; W756158; W755999; W756372; W758508; W757339; W757524; W759370; W760733; W762962; W765476; W765862; W769218; W770904; W771349; W774420; W776511; W778081; W778272	CEDAPRIN	
ZFAK9W/GOLF	W756344	GOLFER'S FAK	
ZFAK4SHLF-CLSB	W769573; W776733	IND W/LINER CLASS B	

PLEASE INCLUDE BOTH PAGES OF THIS FORM WITH YOUR RETURN

